



**DETAILS OF BERM WITH HANDRAILING**

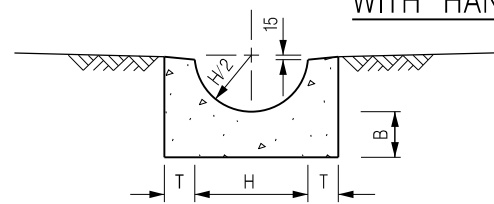

**HALF-ROUND CHANNEL**

**NOTES:**

1. ALL DIMENSIONS ARE IN MILLIMETRES.
2. ALL CONCRETE TO BE GRADE 20 / 20.
3. CONCRETE SURFACE FINISH SHALL BE CLASS U2, F2 OR BRUSHED FINISH AS DIRECTED.
4. SPACING OF EXPANSION JOINT IN CHANNELS, BERM SLABS AND APRONS TO BE 10 METRES MAXIMUM, SEE STD. DRG. NO. C2413 FOR DETAILS.
5. JOINTS FOR CHANNELS, BERM SLABS, APRONS AND WALLS, ETC. TO BE ON THE SAME ALIGNMENT.
6. FOR DIMENSIONS T, H, & B, SEE TABLE BELOW.
7. BIODEGRADABLE EROSION CONTROL MAT IF REQUIRED, SEE STD. DRG. NO. C2511/E.
8. CONCRETE TO BE COLOURED AS SPECIFIED.
9. CONCRETE U-CHANNEL CAN BE CAST IN-SITU OR PRECAST CONCRETE SUBJECT TO THE ENGINEER'S AGREEMENT ON THE DETAILS.
10. DETAILS OF EROSION CONTROL MAT AND WESH MESH ON BERM. (SEE STD DRG. NO. C2511/E)
11. THE WIRE MESH ON HANDRAILING IS OPTIONAL. THE COVER STRIP AND ADDITIONAL MILD STEEL TUBES ARE NEEDED ONLY IF WIRE MESH IS PROVIDED. (SEE STD. DRG. NO. C2103)

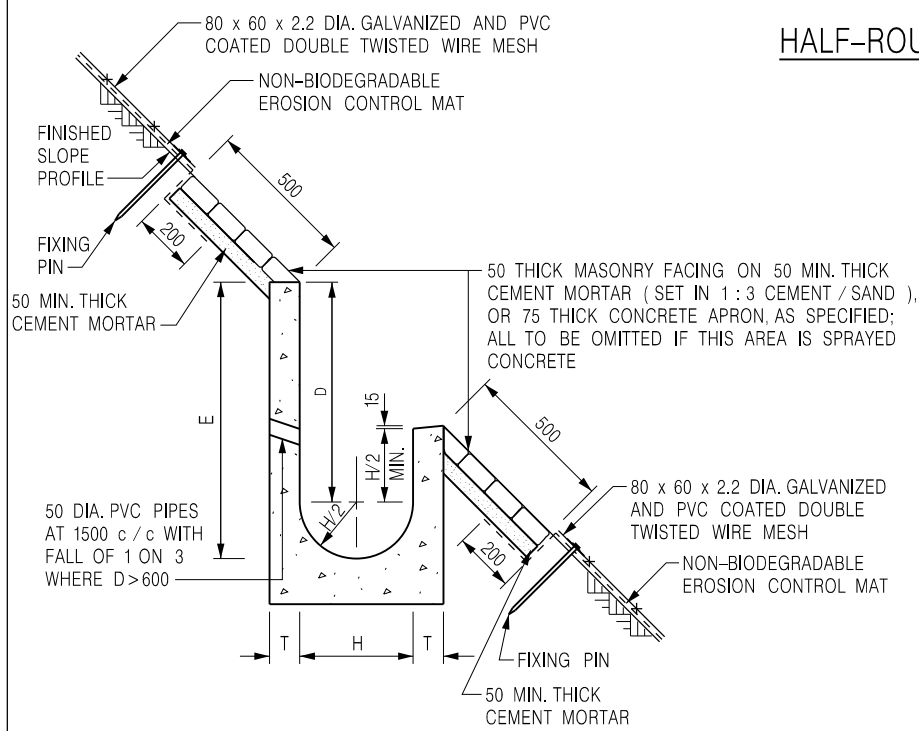

**U-CHANNELS NOT CONSTRUCTED ON BERM**

NOMINAL SIZE H	T	B	REINFORCEMENT
300	80	100	A252 MESH PLACED CENTRALLY AND T=100 WHEN E>650
375 - 600	100	150	
675 - 900	125	175	A252 MESH PLACED CENTRALLY

REF.	REVISION	SIGNATURE	DATE
J	DETAILS OF HANDRAILING AMENDED.	Original Signed	08.2024
I	MINOR AMENDMENT.	Original Signed	07.2018
H	THICKNESS OF MASONRY FACING AMENDED.	Original Signed	01.2005
G	MINOR AMENDMENT.	Original Signed	01.2004
F	GENERAL REVISION.	Original Signed	12.2002

**DETAILS OF HALF-ROUND AND U-CHANNELS (TYPE A - WITH MASONRY APRON)**

**CEDD**  
CIVIL ENGINEERING AND DEVELOPMENT DEPARTMENT

**SCALE** 1 : 25      **DRAWING NO.** C2409J

**DATE** JAN 1991